


UNTRENCHED INSTALLATION

NOTE:

1. Other materials providing equivalent protection against erosive velocities may be substituted for use in silt socks or wattles.
2. Fill silt sock/wattle netting uniformly to the desired length such that logs do not deform.
3. Silt sock/ Wattle should be installed parallel to and a minimum of 10 feet beyond the toe of a graded slope. Silt sock/Wattles located below flat areas should be located at the edge of the land disturbance. The ends of the silt sock/wattles should be turned slightly upslope to prevent runoff from going around the ends of the silt sock/wattles.
4. Oak or other durable hardwood stakes with a 2 inch x 2 inch cross section should be driven vertically plumb, through the center of the silt sock/wattle. Stakes should be placed at a maximum interval of 4 feet or a maximum interval of 8 feet if the silt sock/wattle is placed in a 4 inch trench.
5. In the event staking is not possible (ie. when silt socks/wattles are used on pavement) heavy concrete blocks shall be used behind the silt sock/wattle to hold it in place during runoff events.

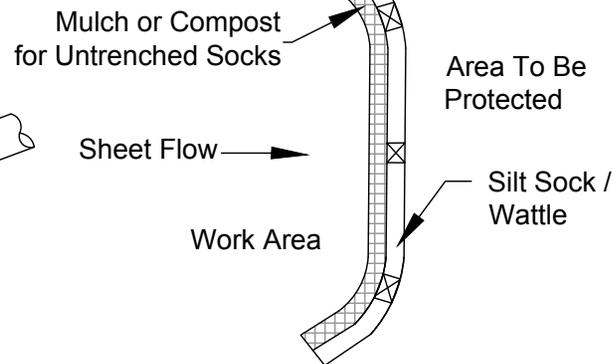

ENTRENCHED INSTALLATION*

*THIS APPLICATION MAY NOT BE USED WITH COMPOST SOCKS SMALLER THAN 12".

COMPOST SOCK INITIAL FLOW RATES					
Compost Sock Design Diameter	8 Inch (200 mm)	12 Inch (300 mm)	18 Inch (450 mm)	24 Inch (600 mm)	32 Inch (750 mm)
Maximum Slope Length (<2%)	600 Feet (183 m)	750 Feet (229 m)	1,00 Feet (305 m)	1,300 Feet (305 m)	1,650 Feet (500 m)
Hydraulic Flow Through Rate	7.5 gpm/ft (941 l/m/m)	11.3 gpm/ft (141 l/m/m)	15.0 gpm/ft (188 l/m/m)	22.5 gpm/ft (281 l/m/m)	30.0 gpm/ft (374 l/m/m)

MAINTENANCE:

1. Inspect Silt sock/wattle weekly and after each rain of 1 inch or greater. Remove accumulated sediment and any debris as needed to allow for adequate flow.
2. Silt sock/Wattle must be replaced if clogged or torn.
3. If ponding becomes excessive, the silt sock/wattle may need to be replaced with a larger diameter or a different measure.
4. Reinstall if damaged or dislodged.
5. Silt socks/Wattles shall be inspected until land disturbance is complete and the area above the measure has been permanently stabilized.